
Temperature metering thermocouple

- Optional analogue output

- Mounting into panels with thickness up to 50 mm



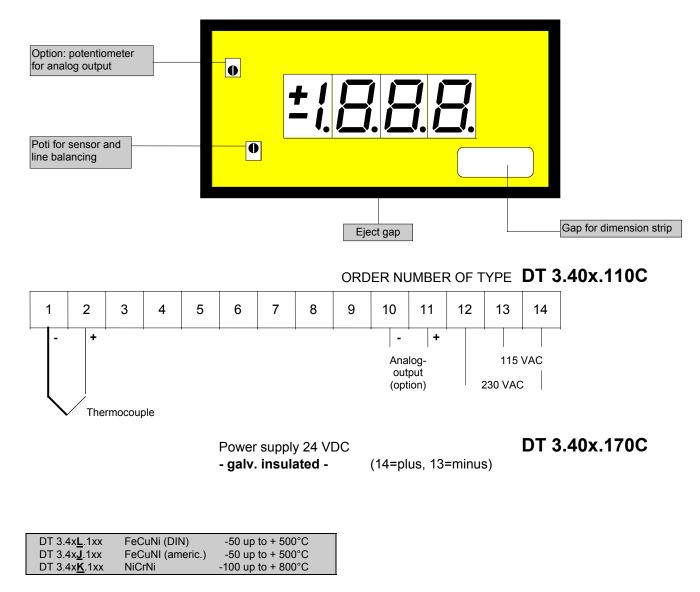


Options

- green LED
- Protection IP54
- Protection IP65
- Analog output 0-10 VDC/10 mA
- Analog output 0-20 mA/load 500 Ω
- Analog output 4-20 mA/load 500 Ω
- •Analog outout 0-10 VDC/10 mA (power supply 24 VDC galvanically insulated)
- Analog output 0-20 mA/load 500 Ω (power supply 24 VDC galvanically insulated)
- Analog output 4-20 mA/load 500 Ω (power supply 24 VDC galvanically insulated)
- Analog output with customer specified offset
- The measuring inputs are not galvanically insulated from the analog output!
- Power supply 24/48 VAC
- Setpoints see type PTE 4.4xx.1xx

Technical data, handling

Dimensions	Housing Assembly cut out Fastening Housing material Protective system Weight Connection	96 x 48 x134 mm, including screw terminal 92.0 ^{+0.8} x 45.0 ^{+0.6} mm special quick plastic clamp proper to fix in wall thickness up to 50 mm PC/ABS-plastic blend, colour black, UL94V-0 at the front IP40 connection IP00 approx. 0.290 kg at the rear side via screw terminals up to 2.5 mm ²
Input	<u>L</u> FeCuNi (DIN) <u>J</u> FeCuNi (americ.) <u>K</u> NiCrNi	-50 up to + 500°C -50 up to + 500°C -100 up to + 800°C
Output	Analog output Final value	0-10 VDC/10 mA (0.1 % of measuring value, +/-0.05 % of full scale) 0-20 mA, 4-20 mA - load 500 Ohm (0.1 % of measuring value, +/-0.05 % of full scale) for 10 V- or 20 mA-output adjustable in a range of 200° up final value
Accuracy	Resolution Measuring fault Temp. drift Measuring principle	1°C +/-1% of measuring value, +/-1 digit 100 ppm/K Dual-Slope-Integration
Power unit	Supply voltage Power consumption	230/115 VAC +/-10 % (50-60 Hz), 24 VDC +/-10 % galvanic insulated approx. 4 VA
Indication	Display Measuring time Wire break	LED with 7 segments, 14 mm high, red 3½-digit = indication1999 1 second by showing " 1 " on the fourth digit
Ambient conditions	Working temperature Storing temperature	0 up to + 60°C -20 up to + 80°C

Gehäuse:

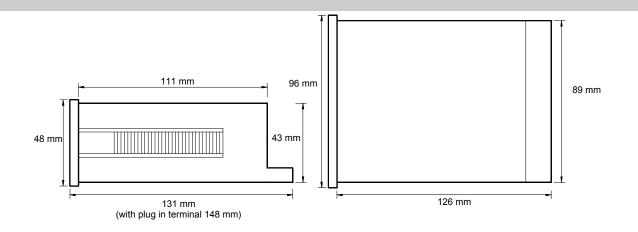

<u>CE-sign</u>

For unlimited use of the instrument within the directives for electromagnetic compatibility 89/336/EC measuring wires have to be used with shielded cable and cable's shield connected to earth ground at one end only.

Setting

The unit is adjusted ex works. Later adjustments are necessary in applications with long distance wiring only.

- 1. Connect the instrument according to the wiring diagram and turn power on.
- 2. Adjusting of line balancing: Remove the front pane by using the eject gap.
- 3. Connect thermocouple simulator and adjust 0°C.
- 4. If necessary deviations on the display have to be corrected with potentiometer for line balancing.