

**Direct voltage 60mV-150mV-300mV - microprocessor based technology**



**48x24**

- Free scalable indication and setpoints from -999 to +9999


- Standard: 2 setpoints, min/max memory - option: analogue output

- Allows to be placed side by side in grid and mosaics systems up to 50 mm

8888

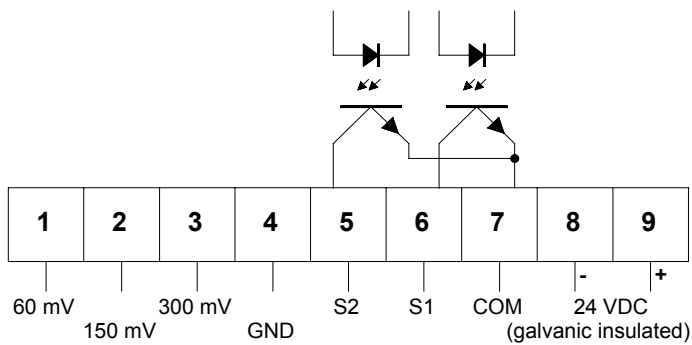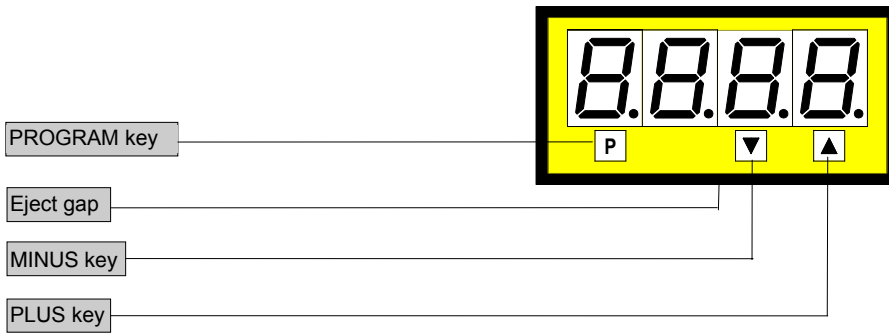

ORDER NUMBER OF TYPE  
**PVE 4.002.7782B**

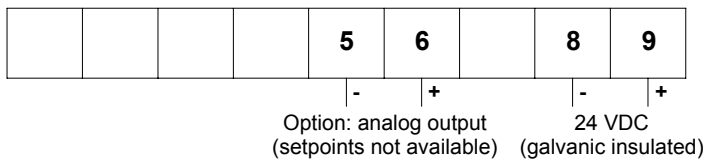


## Options

- green LED
  - protection IP54
  - Plug in terminal with protection IP40
  - Plug in terminal with protection IP54
  - Analog output 0-10 VDC - (12 bit)
  - Analog output 0-20 mA/load 500 Ω
  - Analog output 4-20 mA/load 500 Ω
- With analog output setpoints S1 and S2 are not available!**
- Setpoints as open emitter
  - Dimension strips selectable (8 characters max.)

# Technical data

<b>Dimensions</b>	Housing	48 x 24 x 90 mm, including screw terminal
	Assembly cut out	45.0 <sup>+0.6</sup> x 22.2 <sup>+0.3</sup> mm
	Fastening	special quick plastic clamp proper to fix in wall thickness up to 50 mm
	Housing material	PC/ABS-Blend, colour black, UL94V-0
	Protective system	at the front IP40 connection IP00
	Weight	approx. 75 g
	Connection	at the rear side via plug in connector up to 1.5 mm <sup>2</sup>
<b>Input</b>	Measuring range	0-60 mV, 150 mV, 300 mV all ranges are selectable via connection terminal
	Input resistance	Ri with 60 mV = 15 KΩ 150 mV = 39 KΩ 300 mV = 75 kΩ
<b>Output</b>	Open collector	2 outputs supply by customers (U <sub>B</sub> =5-40 V/I <sub>max</sub> =100 mA)
	Analogue output	0-10 VDC (12 bit) 0-20 mA/load 500 Ohm (12 bit) 4-20 mA/load 500 Ohm (12 bit)
<b>Accuracy</b>	Resolution	-999 up to +9999 digit
	Non-linearity	+/-0.2 % of measuring value, +/- 1 digit
	Temp. drift	150 ppm/K
	Measuring principle	voltage/frequency converter
<b>Power unit</b>	Supply voltage	24 VDC +/-10 % galvanic insulated
	Power consumption	approx. 2 VA
<b>Indication</b>	Display	LED with 7 segments, 10 mm high, red 4-digit = indication 9999
	Overflow	indication of four transversal bars
	Time of indication	adjustable from 0.1 to 10.0 seconds
<b>Ambient conditions</b>	Working temperature	0 up to + 60 °C
	Storing temperature	-20 up to + 80 °C



## Housing:

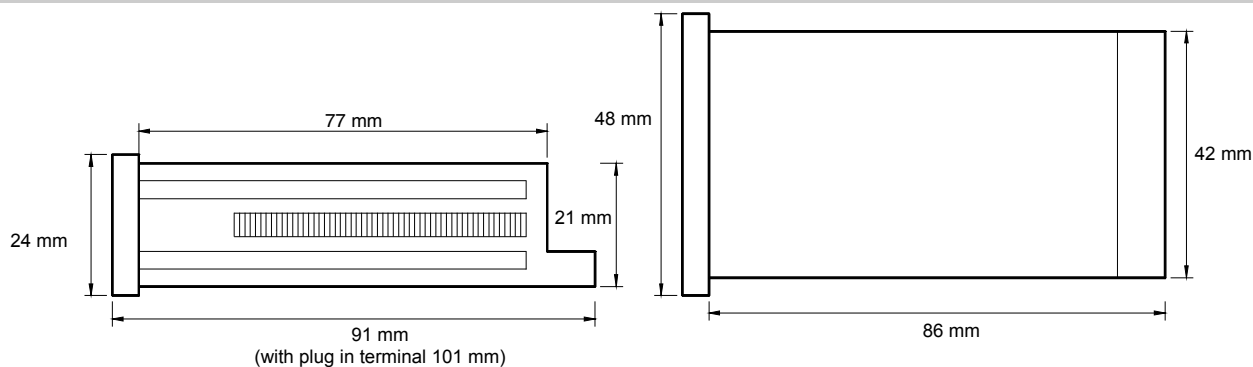

### CE-sign

For unlimited use of the instrument within the directives for electromagnetic compatibility 89/336/EC analogue input wires have to be used with shielded cable and cable's shield connected to earth ground at one end only.

# Connection diagram, programming, remarks

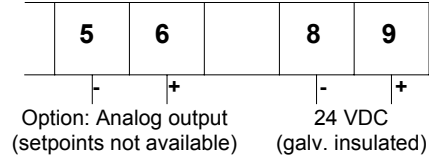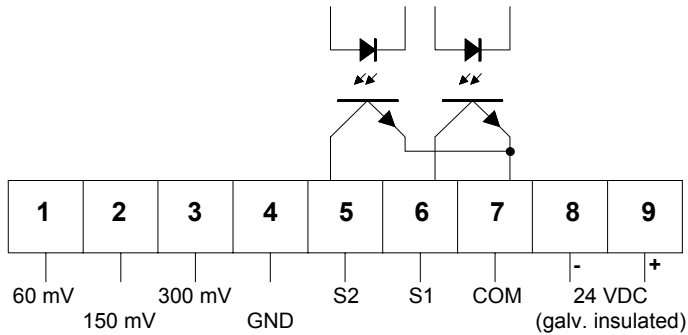

## Setting

1. Detach front pane with a small screwdriver leading between front pane and housing supported by the eject gap.
2. Connect the instrument according to the wiring diagram.
3. After power on, the instrument runs into a lamp test and returns back to the standard mode.
4. Connect the desired measuring value to the measuring input.
5. Pressing the **P**-key enters the program mode with indication of "P1" on the display.
6. Pressing the **P**-key and **▲**-key simultaneously steps through the different program numbers .
7. Pressing **▲** or **▼**-key shows the current values.
8. To change values use **▼**- or **▲**-key.
9. Memorizing of the values under program number 1 and 2 by pressing Plus- and **▼**-key simultaneously . Four transversal bars are indicating memorization.
10. Otherwise the remaining values will be memorized automatically 7 seconds after the last touch of key with leaving program mode.

## Additional key-functions in standard-mode for indication of min/max values.

Simultaneously pressing of **▼** and **▲** key deletes and actualizes min/max-memory.

**▲** key enters max-memory.

**▼** key enters min-memory.

## Instructions


After power on the instrument with his inbuilt microcontroller starts with an initial program activating lamp test and readout of memorized parameters in an EEPROM. In case of loosing parameters or any defects in hardware the system generates an error message "HELP". This function prevents damage from peripherals and human life, totally reset is required. After a new power on, the system remains in lamp test while pressing **P**-key. Then the unit storages the default parameters and is ready for new programming.

The unit you've bought provides several different voltage inputs as well as optional analog output and open collector setpoints. In order to achieve the maximum value indication of 9999, the following minimum input voltage are required at the various measuring inputs:


Measuring input	60 mV	150 V	300 mV
U/I min	30 mV	60 mV	150 mV
U/I max	80 mV	180 mV	360 mV

The following diagrams are showing the switching operation of PVE4 open collector outputs, the hysteresis is free programmable. There are two kinds of operation:

### Example: operation current

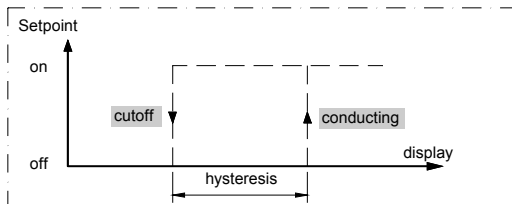

### Example: quiescent current

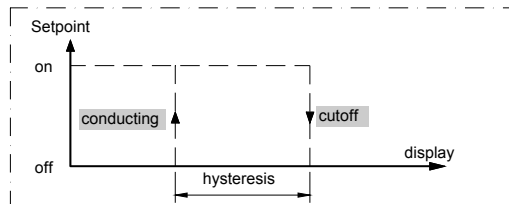

Operation current means that the open collector will be conducted if reaching the adjusted setpoint.

Quiescent current means that the open collector will be cutoff if reaching the adjusted setpoint.

# Operation, setting instructions

subject to technical alteration – status 02/2006 - PVE427GB.DOC

## Program table 1


Program-Number (PN)	Function	Remark	Display	basic parameter after reset
1	Input of the desired indication value	Feed measured magnitude (acknowledged by pressing key <b>P</b> and <b>▼</b> ) e.g. 60 mV measuring input = final value 3500	-999 to +9999	2000
2	Input of offset for indication value	Feed measured magnitude (acknowledged by pressing key <b>P</b> und <b>▼</b> ) e.g. 0 mV measuring input = initial value 0	-999 to +9999	0
3	Setting of decimal point	Press <b>▲</b> until desired decimal point is shown		no dec. point
4	Input of display time	Display time = measuring time Method of measurement integrating	0.1 to 10.0 seconds	1.0
5	Input of final value for analog output	Option	-999 to +9999	2000
6	Input of offset for analog output	Option	-999 to +9999	0

## Program table 2 (Setpoints)

S1 PN	S2 PN	Function	Display	basic parameter after reset
61	66	Setpoint	-999 to +9999	500 / 1500
62	67	Hysteresis	0 to +9999	1
63	68	Quiescent current	0	0
		Operating current	1	-

## Example for programming

**Measuring input:** 0-150 mV  
**Measuring value:** 100 mV  
**Display:** 0 mV=0.0    100 mV=300.0  
**Displ.refresh time:** 2.0 seconds  
**Setpoints:** S1 ==> 60.0 and quiescent current  
                   open collector conducting = 58.0 ==> hysteresis 2.0  
                   S2 ==> 150.0 and operation current  
                   open collector cut off = 80.0 ==>hysteresis 70.0  
**Analog output:** 0 V output ==> display 0.0==>measuring value 0 mV  
                   (no setpoints) 10 V output==> display 300.0==>measuring value 100 mV

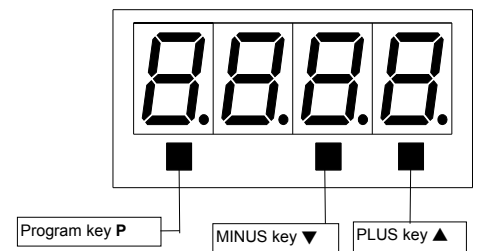

The basic adjustments concerning to the following program example are the ground parameters after a total reset occuring through a power on with pressing **P**-key (see previous page).

### Program advices:

Pressing the **P**-key enters **always** the program mode with program number 1. The "P1" starts to blink in change with the current value after 3 seconds. After further 4 seconds the system leaves the program mode and goes to the standard mode. In program mode pressing **▼** or **▲**-key selects the current values which are free scalable with both the keys. In program number 1 and 2 the memorization will be executed by pressing **P** and **▼** simultaneously - four transversal bars indicate the storage. All the other parameters will be memorized automatically after leaving program mode.


### Programming

Switch power on!


Lamp test



Standard mode



Connect 100 mV to the measuring input. Enter program mode.




To memorized value with **▼** or **▲**.




Set free scalable value




Memorize value with **P** and **▼**. Take over by display of transversal bars.




To program-number 2 with **P** und **▲**



Connect measuring value 0 mV. To memorized value with **▼** or **▲**.




Memorize value with **P** and **▼**. Take over by display of transversal bars.




# Example for programming


To program number 3 with P and ▲.




To memorized value with ▼ or ▲.




Set decimal point.



To program number 4 with P and ▲.



To memorized value with ▼ or ▲.




Set display time.



The following programming steps are necessary for the setpoint programming of S1 and S2 only.

To program number 61 with P and ▲.



To memorized value with ▼ or ▲.




Set free scalable value for setpoint S1



To program number 62 with P and ▲.




To memorized value with ▼ or ▲.




Set hysteresis for S1.



To program number 63 with P and ▲.



To memorized value with ▼ or ▲.



To program number 66 with P and ▲.



To memorized value with ▼ or ▲.



Set free scalable value for setpoint S2.



To program number 67 with P and ▲.




To memorized value with ▼ or ▲.




Set hysteresis for S2.




To program number 68 with P and ▲.



To memorized value with ▼ or ▲.



Set operation current.




**Programming finished.**

All programmed values are memorized after 7 seconds. Jumps back into standard mode automatically.

The program numbers 5 and 6 are available with option analogue output only.

To program number 5 with P and ▲.




To memorized value with ▼ or ▲.




Set free scalable final indication value for analogue output.



To program number 6 with P and ▲.



To memorized value with ▼ or ▲.



**Programming finished.**

All programmed values are memorized after 7 seconds. Jumps back into standard mode automatically.